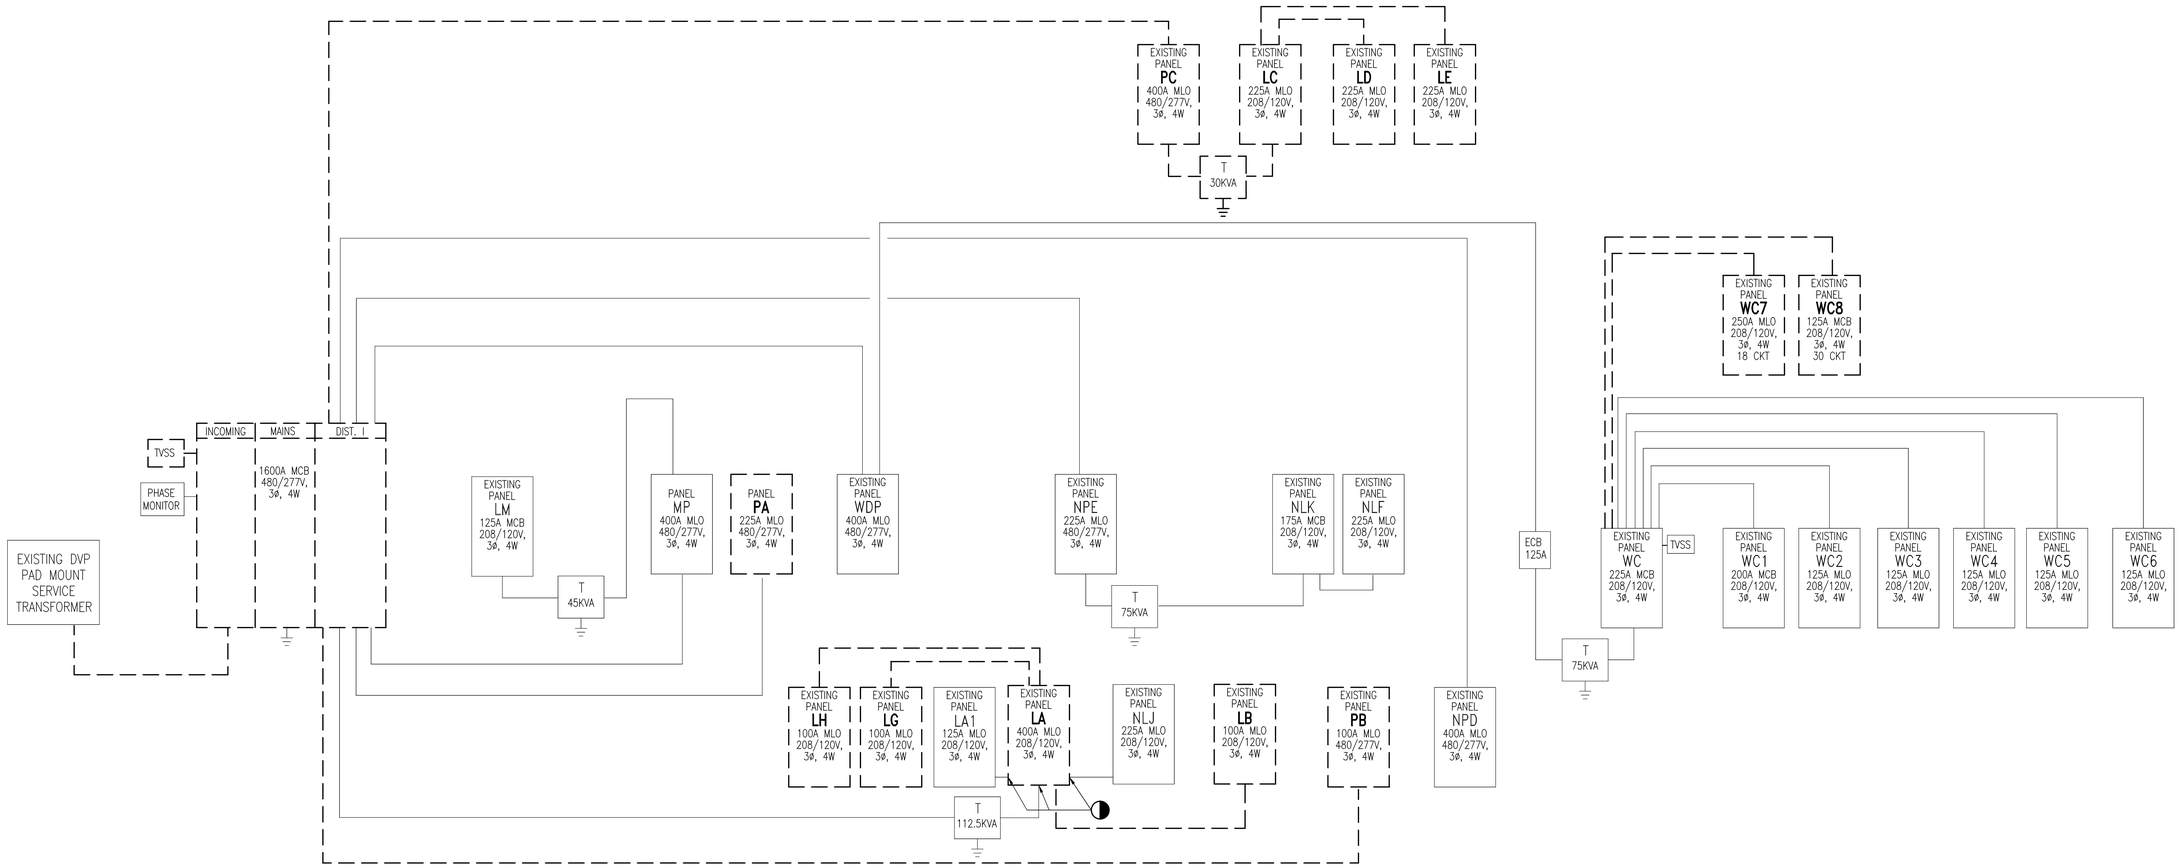
EXISTING PANEL PC 400A MLO 480/277V, 3ø, 4W
EXISTING PANEL LC 225A MLO 208/120V, 3ø, 4W
EXISTING PANEL LD 225A MLO 208/120V, 3ø, 4W
EXISTING PANEL LE 225A MLO 208/120V, 3ø, 4W
T 30KVA
EXISTING PANEL WC7 250A MLO 208/120V, 3ø, 4W 18 CKT
EXISTING PANEL WC8 125A MCB 208/120V, 3ø, 4W 30 CKT
INCOMING
MAINS
DIST. I
TVSS
PHASE MONITOR
1600A MCB 480/277V, 3ø, 4W
EXISTING DVP PAD MOUNT SERVICE TRANSFORMER
EXISTING PANEL LM 125A MCB 208/120V, 3ø, 4W
T 45KVA
PANEL MP 400A MLO 480/277V, 3ø, 4W
PANEL PA 225A MLO 480/277V, 3ø, 4W
EXISTING PANEL WDP 400A MLO 480/277V, 3ø, 4W
EXISTING PANEL NPE 225A MLO 480/277V, 3ø, 4W
T 75KVA
EXISTING PANEL NLK 175A MCB 208/120V, 3ø, 4W
EXISTING PANEL NLF 225A MLO 208/120V, 3ø, 4W
ECB 125A
T 75KVA
EXISTING PANEL WC 225A MCB 208/120V, 3ø, 4W
TVSS
EXISTING PANEL WC1 200A MCB 208/120V, 3ø, 4W
EXISTING PANEL WC2 125A MLO 208/120V, 3ø, 4W
EXISTING PANEL WC3 125A MLO 208/120V, 3ø, 4W
EXISTING PANEL WC4 125A MLO 208/120V, 3ø, 4W
EXISTING PANEL WC5 125A MLO 208/120V, 3ø, 4W
EXISTING PANEL WC6 125A MLO 208/120V, 3ø, 4W
EXISTING PANEL LH 100A MLO 208/120V, 3ø, 4W
EXISTING PANEL LG 100A MLO 208/120V, 3ø, 4W
EXISTING PANEL LA1 125A MLO 208/120V, 3ø, 4W
EXISTING PANEL LA 400A MLO 208/120V, 3ø, 4W
EXISTING PANEL NLJ 225A MLO 208/120V, 3ø, 4W
EXISTING PANEL LB 100A MLO 208/120V, 3ø, 4W
EXISTING PANEL PB 100A MLO 480/277V, 3ø, 4W
EXISTING PANEL NPD 400A MLO 480/277V, 3ø, 4W
T 112.5KVA

POWER RISER DIAGRAM – DEMOLITION

NO SCALE

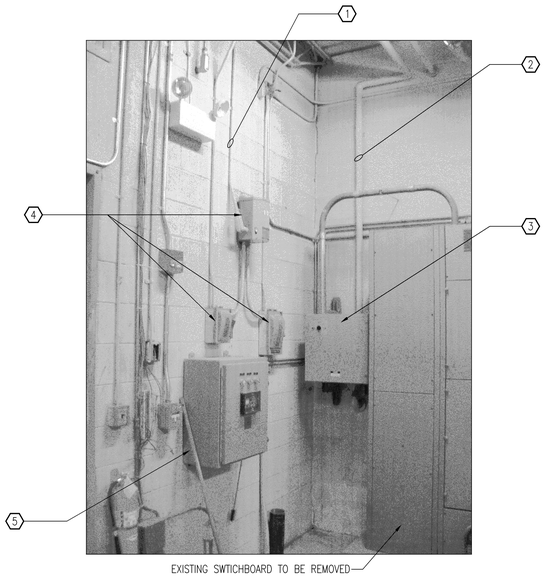

P1 DEMOLITION PHOTO DETAIL

ED–1W E5.1W

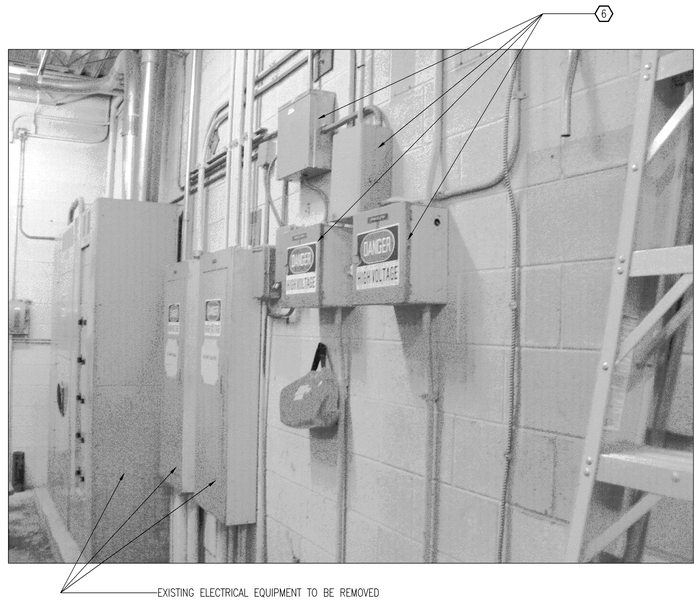

P2 DEMOLITION PHOTO DETAIL

ED–1W E5.1W

DEMOLITION NOTES THIS SHEET

1. DISCONNECT AND REMOVE CONDUIT AND WIRING FOR HEAT TAPE CONNECTION TO WATER PIPING ABOVE.
2. EXISTING COLD WATER PIPING REMOVED BY PLUMBING.
3. DISCONNECT AND REMOVE TVSS
4. EXISTING EQUIPMENT SHALL REMAIN FOR CONNECTION TO NEW SERVICE IN ORDER TO SERVE ANY EMERGENCY LOADS TO REMAIN THAT ARE NOT AFFECTED BY WORK IN THIS CONTRACT.
5. EXISTING PHASE MONITORING PANEL SHALL REMAIN FOR CONNECTION TO NEW SERVICE.
6. EXISTING EXTERIOR LIGHTING CONTROL EQUIPMENT SHALL REMAIN FOR RECONNECTION TO NEW ELECTRICAL

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260–17712

WARSAW CAMPUS ELECTRICAL
POWER RISER DIAGRAM – DEMOLITON

Date: JANUARY 13, 2010

REVISIONS	
NO.	DATE

COMMONWEALTH OF VIRGINIA
JAMES S. BEDDIS
Lic. No. 032929
PROFESSIONAL ENGINEER
1-13-10

Sheet
E5.1W
File Number

PACE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA • 757-499-7229